

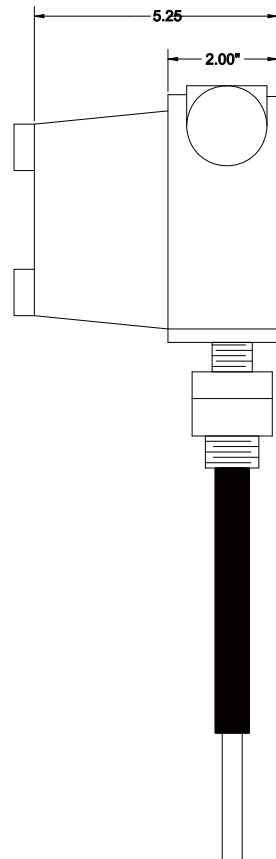
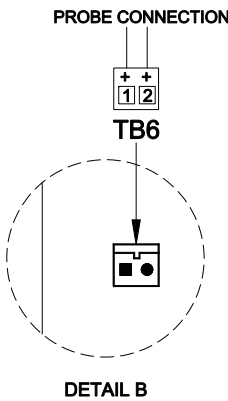


NOTE:
LENGTH "L1" & "L2" SPECIFY BY CUSTOMER AT THE TIME OF ORDER.

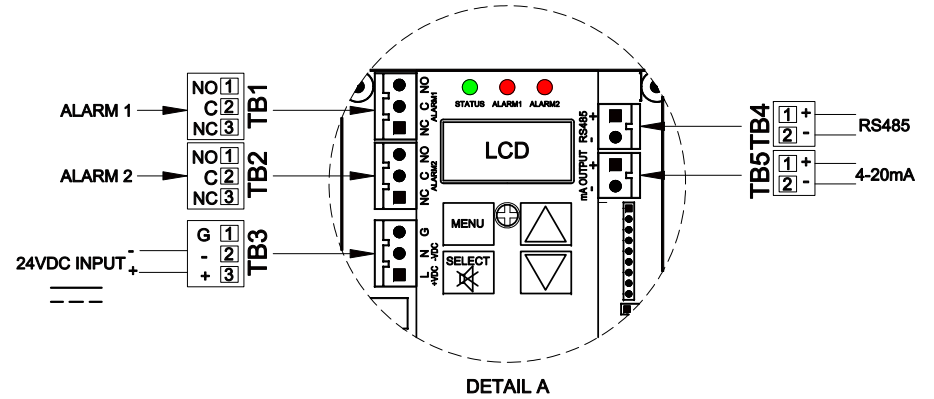

EXPLOSION-PROOF HOUSING
CL. I GR. B,C,D
CL. II GR. E,F,G
CL. III
TYPE 3 & 4

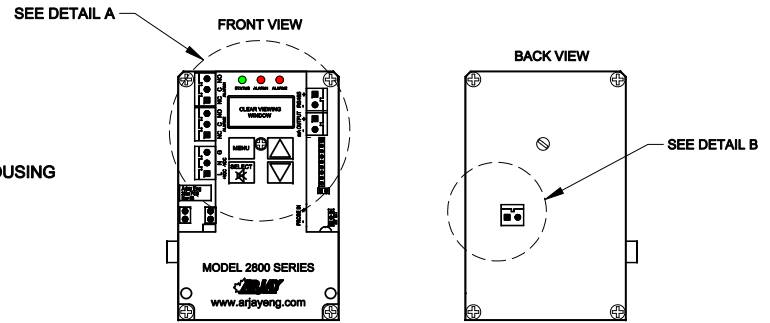

CONTROLLER MODEL: 2880 SERIES

MODEL	DESCRIPTION
2880	PROBE MOUNTED 4-20mA (NON-ISOLATED)
2881	PROBE MOUNTED 4-20mA (ISOLATED)
2882	PROBE MOUNTED 4-20mA (NON-ISOLATED) C/W RELAYS

REV	DATE	DESCRIPTION	CHKD	APPD
REVISIONS				
			PROJECT:	
DWC. STATUS		BY	DATE	TITLE
DRAWN		F.H.	15 07 11	2880 SERIES PROBE MOUNT DIMENSIONAL & ELECTRICAL
CHECKED				
APPROVED				
SCALE	REF. DWGS.	DWG. NO.		
N. T. S.			20100044	SHT. 1 REV. 0