



**MODEL 9830  
REMOTE MOUNTED LEVEL SWITCH  
WITH DIFFERENTIAL**

**User Manual**

Technical Support  
Continental North America Toll Free 1-(800) 387-9487  
Ph: +1 (905) 829-2418 Fx: +1 (905) 829-4701

A Product of Arjay Engineering Ltd.  
Oakville, Ontario, Canada

INTERNET [www.arjayeng.com](http://www.arjayeng.com)

## Description

The 9820 and 9830 provides an economical means to alarm on the high or low condition of a liquid or bulk solids vessel.

The 9820 electronics are mounted directly onto the probe for easy and compact installation. For applications that require the control circuitry and relays remote from the vessel, the 9030 employs the Arjay Pulse Module Circuit (PMC). This allows the electronics to be mounted up to 1 km away from the probe using inexpensive 2-conductor shielded wire.

On a rise or fall of product around the probe, a relay contact closure will be initiated for remote control and alarms. On a vertical probe, a differential can be set to cycle the relay on and off between two distinct points along the length of one probe. This is typical of pump or valve cycling to control the useage and refilling of tanks.

Additional standard features include an adjustable time delay (Delay On or Off), fail-safe selection, 0-100% differential, a DPDT relay, and a simple push button calibration to set the unit up. The unit can be calibrated in an alarm or normal process operating state.

## Operation

The probe, mounted into a vessel, forms a capacitor with the tank wall or ground reference. When the product changes on or around the probe, the capacitance also changes, which is acknowledged and used to activate the relay.

The probe can be calibrated in one of three states:

- 1) in air above the product, to alarm when the product approaches or touches the probe,
- 2) submerged in the product, to alarm when the product drops below the probe, and
- 3) with product on a vertical probe at a specific level.

For vertical probes with a setpoint along the length of the probe, a consistent material dielectric will ensure a consistent and repeatable alarm point. For probes calibrated in air or submerged to alarm in air, a consistent product dielectric is not required.

## Specifications (typical)

Housing:	Explosion Proof cast aluminum, epoxy coated
Power Input:	110 VAC, 220 VAC, 50/60 Hz 24 VDC, (12 VDC on 9820 only) (Specify at time of order)
Relay:	DPDT, 5amp @ 240 VAC, Dry Contact
Sensitivity:	.5 pf
Accuracy:	+/- 2 mm
Time Delay:	Field Selectable 0 to 30 seconds
Fail-Safe:	High or Low Selectable
Temperature:	Electronics: -40 C to +60 C Probe: -60 C to +260 C
Wetted Parts:	316SS and Teflon
Process Connection:	3/4" npt standard
Pressure Rating:	max 1500 psi

Alternate housing, probe materials, and process connections are available.


## Arjay Engineering Ltd.

Tel: +1 (905) 829-2418 / 1-800-387-9487(N.America) Fax: +1 (905) 829-4701  
www.arjayeng.com • E-mail: arjay@arjayeng.com



## Level Alarm Switch with Differential

### Model 9820 Model 9830

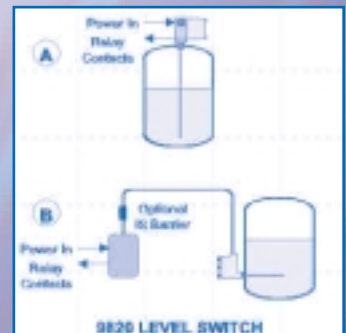

## Applications

- Pump Cycling Control
- Liquid and Bulk Materials
- Overflow Spill Control
- Proximity Alarms
- High and Low Alarms

## Related Materials

- Dwg. 990200 (9820)
- Dwg. 990201 (9830)
- Operation Manual
- Sample Probe Installations

See Model 9060 series for mult-point alarms

<u>MODEL</u> <b>9830 DIFF. LEVEL SWITCH</b>	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> <b>09/19/2003 4:25 PM</b>	<u>PRINT DATE</u> 09/19/2003 4:25 PM	

## TABLE OF CONTENTS

1.0	INSTRUMENT OVERVIEW.....	3
1.1	FEATURES .....	3
1.2	DESCRIPTION .....	3
2.0	INSTALLATION .....	5
2.1	PROBES.....	5
2.2	PROBE INSTALLATION .....	5
2.2	ELECTRICAL INSTALLATION.....	7
3.0	STARTUP AND CALIBRATION .....	8
3.1	CALIBRATION OVERVIEW .....	8
3.2	POWERUP .....	8
3.3	DIFFERENTIAL LEVEL SWITCH CALIBRATION .....	9
3.4	SINGLE POINT LEVEL SWITCH CALIBRATION.....	9
3.5	ALARM SETTINGS .....	10
4.0	APPLICATIONS .....	12
5.0	TROUBLESHOOTING .....	14

<u>MODEL</u> <b>9830 DIFF. LEVEL SWITCH</b>	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> <b>09/19/2003 4:25 PM</b>	<u>PRINT DATE</u> 09/19/2003 4:25 PM	

## 1.0 INSTRUMENT OVERVIEW

### 1.1 FEATURES

- Push-button calibration
- RF Technology
- Remote level probe
- Double pole Double Throw (DPDT) 5A relay contacts
- 0 – 20 second time delay
- Adjustable sensitivity
- High and Low (differential) alarm points
- High or Low relay action
- No moving parts
- For use with any Arjay Capacitance probe

### 1.2 DESCRIPTION

The unit senses level using a RF capacitance measurement technique together with microcontroller technology for high resolution level measurements. A probe mounted in a vessel forms a capacitor with the vessel wall, or with a concentric shield around the probe for non-metallic vessels (ground reference). The capacitance of this arrangement is measured by the 9830 and is used to provide point or differential level switch control. The 9830 RF capacitance measurement technique minimizes the effects of other electrical properties of the probe, vessel and the vessel contents and focuses only on the vessel capacitance. The level switch may be located up to 1 km away from the probe.

High and low alarms are easily set with push-button convenience for differential level applications such as sump pump control. For single point applications, the high and low points are set to the same value.

The control relay is always in failsafe mode. The relay action may be set for high or low acting.

For horizontal probes, proximity sensors, or Flow Detector sensors, the unit can be calibrated without the level being at the alarm level.

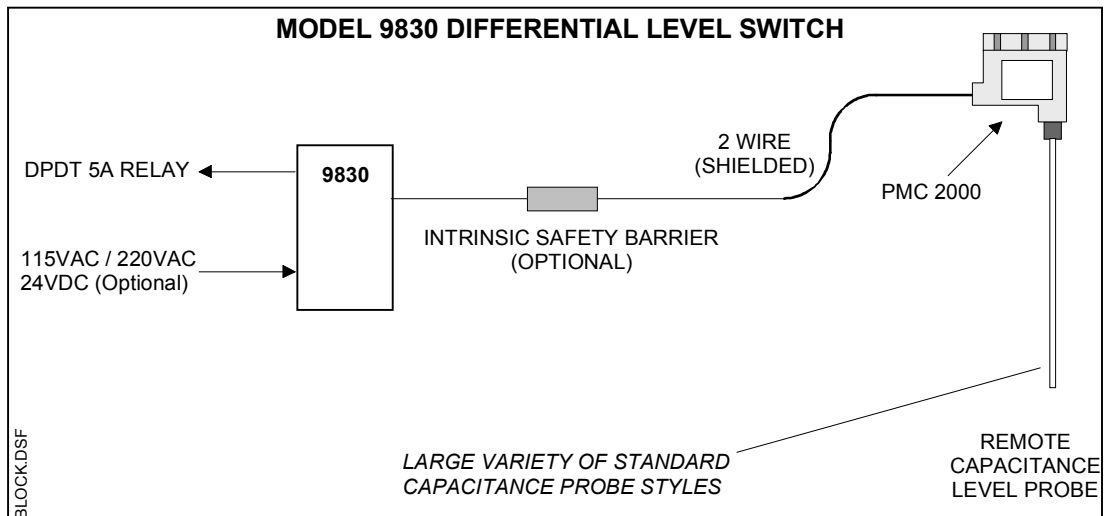


Figure 1.0

<u>MODEL</u> <b>9830 DIFF. LEVEL SWITCH</b>	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> <b>09/19/2003 4:25 PM</b>	<u>PRINT DATE</u> 09/19/2003 4:25 PM	

## OPERATION

The unit uses an RF Capacitance measurement technique for high resolution measurements. A probe mounted in a vessel forms a capacitor with the vessel wall (or with a concentric shield around the probe for non metallic vessels). The capacitance of this arrangement is measured by the 9830 to provide point or differential level switch control.

## USER INTERFACE

Instrument status	2 color indicator: Green for normal operation, Red = instrument error, Red/Green (orange) for calibration confirmation.
Alarm Status	Red indicator: On when not in alarm, Off when in alarm.
Time delay	0 – 20 seconds.
Relay action	High or Low relay action. For high action, the alarm is set when the capacitance value rises above the high alarm point and is reset when the capacitance drops below the low alarm point. For low action, the alarm is set when the capacitance drops below the low alarm point and is reset when the capacitance rises above the high alarm point.
Dielectric switch	Primarily used in horizontal probe, proximity plate sensor, flow sensor applications to indicate if the probe is at or not at the alarm point at calibration time.

## PERFORMANCE

Resolution	The unit measures capacitance in pF. Capacitance to Level translation depends on the tank geometry and the type of material being measured. Capacitance: 0.4% of measured capacitance. Example: at 50pF, the resolution is 0.2pF and at 100pF, the resolution is 0.4pF. For a 5 ft. vertical, concentrically shielded probe in water, this translates to about 0.2" of level. For shorter probe lengths the resolution is higher (0.1" for a 2.5 ft. concentrically shielded probe).
------------	---

## PROBE CONNECTION

None for integral probe (standard) unit: Factory wired internal to enclosure.  
For optional remote probe units: 2 wire + shielded cable to probe.

## RELAY Contacts

Failsafe. DPDT 5A (resistive load) /250VAC/30VDC dry contacts.  
Selectable high or low acting alarm.

## POWER

115VAC or 220VAC @ 25mA max.  
24VDC @ 60mA max.

## MECHANICAL SPECIFICATIONS

Enclosure	Standard: Nema 4X
Dimensions /Weight	8.5" (215mm) x 7" (178mm) x 4.5"(114mm) depth / 4lbs. (1.81kg)

## ENVIRONMENTAL SPECIFICATIONS

Operating Temp.	-20 to 60°C for Controller only. For remote probe:-40 to 80°C
Relative Humidity	90% max. with no condensation.

<u>HARDWARE REV.</u> 1.0	<u>SOFTWARE REV.</u> 9820_06 and higher	Page 4 of 14
-----------------------------	--	--------------

<u>MODEL</u> 9830 DIFF. LEVEL SWITCH	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> 09/19/2003 4:25 PM	<u>PRINT DATE</u> 09/19/2003 4:25 PM	

## 2.0 INSTALLATION

**NOTE: If any damage to the instrument is found, please notify an Arjay Engineering representative as soon as possible prior to installation.**

### 2.1 PROBES

Capacitance probes may be selected from a variety of styles for use with liquids, liquid interfaces, and granular materials. The probe length is customer specified for the height of material to be measured. Usually Teflon coated probes are used.

### 2.2 PROBE INSTALLATION

Standard probe entry in to a tank is via a 3/4" NPT opening (standard probes) or 1" NPT opening (heavy duty probes). Flanges and concentric shields are available as options. The entrance configuration may vary depending on the application requirements.

USE WRENCH ON LOWER HEX . The probe fittings are compression type with Teflon ferrules assembled by applying torque between the two hex sections. The fittings are sealed at the factory to provide a compression seal capable of withstanding high pressures. Once the fittings are opened they cannot be reassembled without replacing the ferrules.

Probe mounting depends on the type of probe used. The following are points to consider:

- Reference ground:** This is VERY IMPORTANT and is typically the metal walls of the tank. For non-metallic tanks, a concentrically shielded probe is required in which case the shield provides its own Ground. IMPORTANT: For standard threaded entry and flange entry probes (without concentric shields), make sure the fittings are clean to ensure a GOOD ELECTRICAL CONNECTION BETWEEN THE PROBE HEAD ENCLOSURE AND THE TANK (REFERENCE GND). For horizontally mounted probes, the reference ground is not as important since the change in capacitance between alarm and no alarm is generally large. It is important that there are no moving objects in the probe vicinity to avoid false alarms.
- The distance between the probe and the ground reference:** This only applies to standard probes without concentric shields. The closer the distance to the tank wall, the greater the sensitivity of measurement; too close and bridging problems may occur.
- Horizontal probe mounting:** A horizontally mounted rod type probe should be mounted so that the lower face of the probe is parallel to and at the level of the desired alarm point. For viscous materials that have a tendency to cling to buildup, the probe should be mounted at a slight angle downwards to allow the material to drain off the probe.
- Vertical probe mounting:** vertically mounted rod type probe should be mounted so that its midpoint is at the desired alarm point for single point applications. This allows a greater variation if the alarm point is later required to be changed. The alarm point may be calibrated anywhere along the length of the probe.
- Location:** Avoid installing rod type probes in nozzles or recesses where material can accumulate false readings.
- The measurement accuracy is affected by the temperature change of the material in the tank.** The amount of measurement error depends on the material. If the temperature change is

<u>HARDWARE REV.</u> 1.0	<u>SOFTWARE REV.</u> 9820_06 and higher	Page 5 of 14
-----------------------------	--	--------------

<b>MODEL</b> 9830 DIFF. LEVEL SWITCH	<b>DOCUMENT TYPE</b> USER MANUAL	<b>DOCUMENT FILE NAME</b> 9830UM12.DOC	<b>REV.</b> 1.2
<b>CREATE DATE</b> 03/27/2003 9:06 PM	<b>REV. DATE</b> 09/19/2003 4:25 PM	<b>PRINT DATE</b> 09/19/2003 4:25 PM	

excessive, temperature correction will be required. Contact the Arjay representative for more information.

7. **Agitators or moving objects in the tank:** Moving objects in the tank close to the probe such as agitator blades, moving baffles etc. appear as moving ground references to a capacitance probe and will cause measurement errors. In applications where these objects are present, a concentrically shielded probe must be used.

**CAUTION:** INSTALL PROBE WITH CARE: DAMAGE TO TEFLON SHEATH WILL CAUSE MEASUREMENT ERRORS.

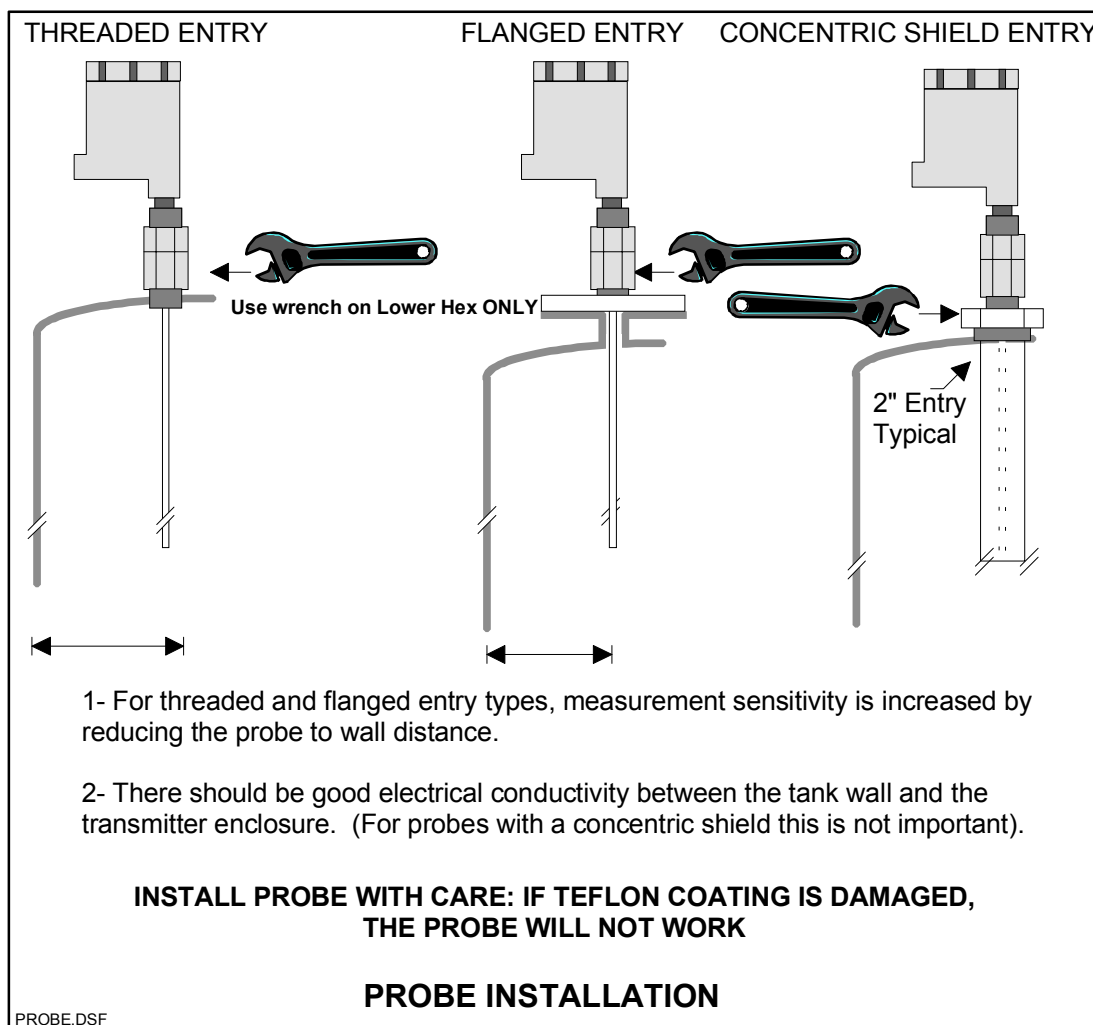


Figure 2.0

<u>MODEL</u> <b>9830 DIFF. LEVEL SWITCH</b>	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> 09/19/2003 4:25 PM	<u>PRINT DATE</u> 09/19/2003 4:25 PM	

## 2.2 ELECTRICAL INSTALLATION

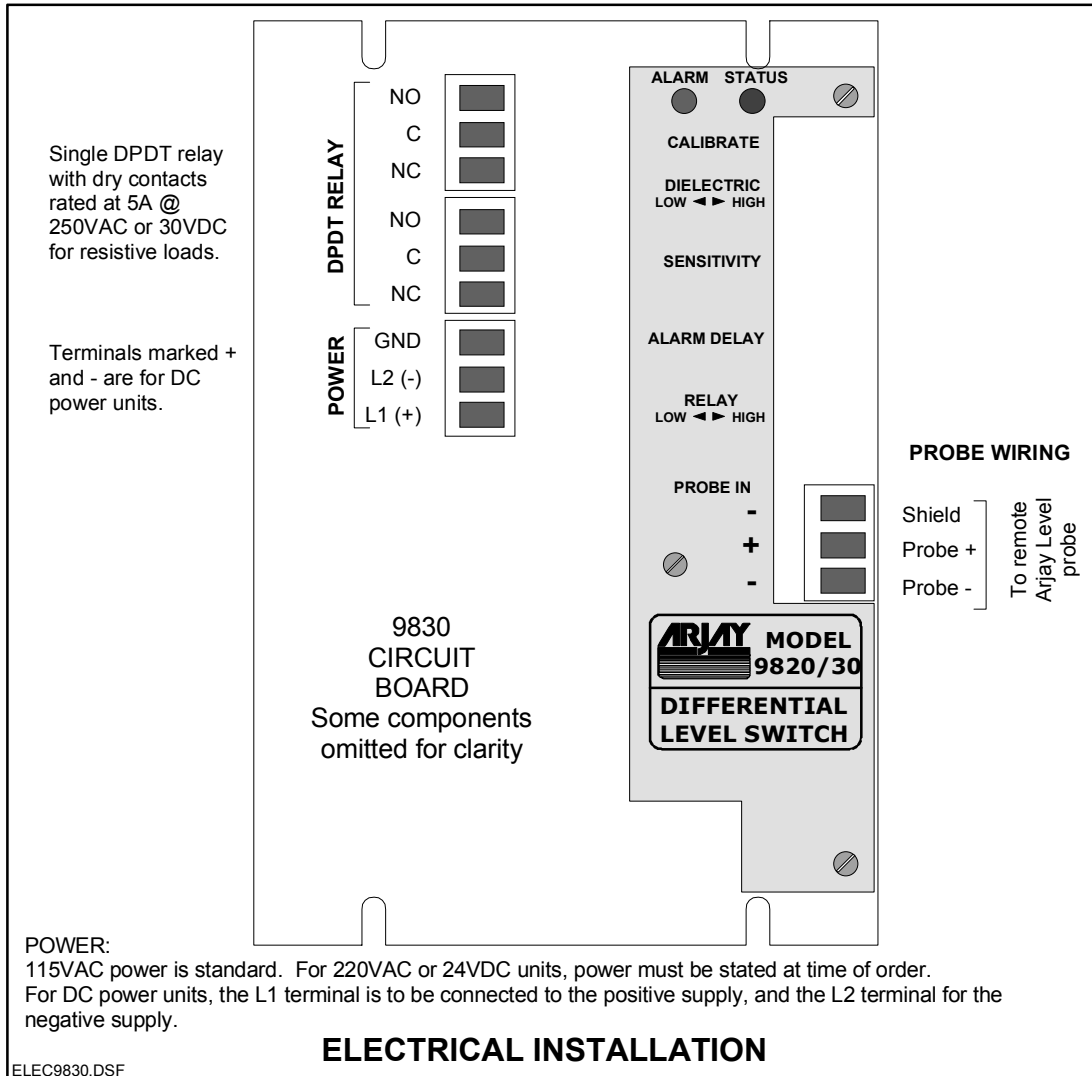


Figure 2.2

### NOTE:

**115VAC power is standard. Other power supply voltages are supported (220VAC, 24VDC) and must be specified at time of order.**

**APPLYING POWER THAN THAT MEANT FOR THE UNIT MAY CAUSE DAMAGE AND OR INJURY.**

<u>HARDWARE REV.</u> 1.0	<u>SOFTWARE REV.</u> 9820_06 and higher	Page 7 of 14
-----------------------------	--	--------------

<u>MODEL</u> <b>9830 DIFF. LEVEL SWITCH</b>	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> <b>09/19/2003 4:25 PM</b>	<u>PRINT DATE</u> 09/19/2003 4:25 PM	

### 3.0 STARTUP AND CALIBRATION

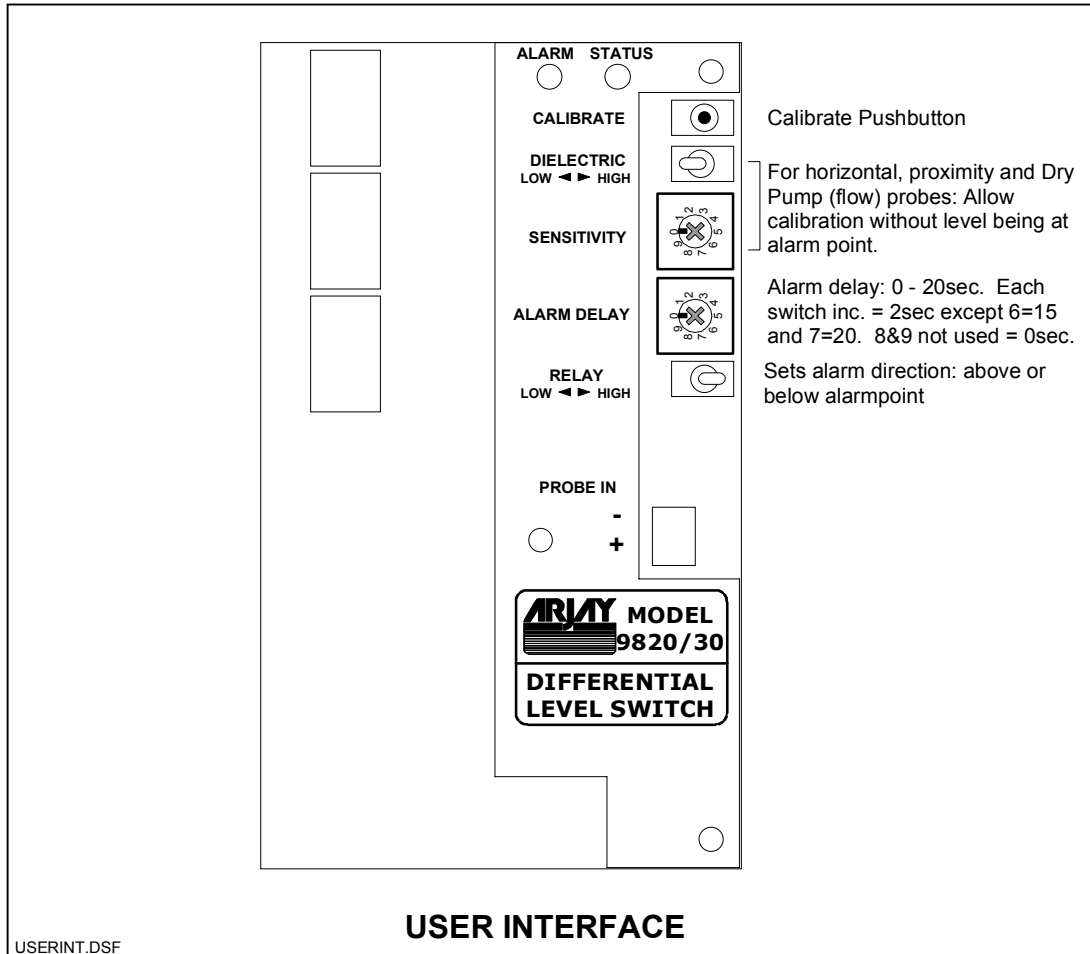


Figure 3.0

#### 3.1 CALIBRATION OVERVIEW

The type of probe and application determines calibration and switch settings. There are 2 main application types:

1. Differential level control. This application requires the use of a vertical probe.
2. Single point level switch using a vertical probe, horizontal probe, proximity sensor, or Dry Pump (Flow detection) probe.

#### 3.2 POWERUP

After the unit has been installed as per the installation procedure in section 2, power up the unit. The Status indicator should be Green. The red Alarm indicator may be on or off and is not valid until a successful calibration has been done.

If the Status indicator is red refer to the troubleshooting procedure in section 5.0 for details.

<u>MODEL</u> <b>9830 DIFF. LEVEL SWITCH</b>	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> <b>09/19/2003 4:25 PM</b>	<u>PRINT DATE</u> 09/19/2003 4:25 PM	

### 3.3 DIFFERENTIAL LEVEL SWITCH CALIBRATION

This application requires a vertically mounted probe. Along the vertical length of the probe, the high and low alarm points will be calibrated.

For this application, the Dielectric and Sensitivity switch settings are not important. They should be set to Low and 0 respectively.

1. Bring the level to the first alarm point. This can be the high or low alarm level. After calibration, the 9830 automatically assigns the high alarm point to the point with the higher measured capacitance.
2. Press the Calibrate push-button until the Status indicator glows orange. The Status indicator then starts flashing green indicating that the first alarm point has been stored.
3. Bring the level to the second alarm point. Press the Calibrate push-button until the Status indicator glows orange.
4. This completes the calibration procedure.

Please refer to section 3.6 for setting the time delay and relay action. Also refer to the Applications section for examples.

### 3.4 SINGLE POINT LEVEL SWITCH CALIBRATION

The 9830 is a differential level switch so for single alarm points, the high and low alarm points must be calibrated for the same level.

For horizontal probes, proximity sensors, and Dry Pump monitors (Flow switch) application, the 9830 allows calibration without requiring the level to be at the alarm point. This is done using the Dielectric and Sensitivity switch settings. NOTE: FOR VERTICAL PROBES, CALIBRATION SHOULD BE DONE WITH THE LEVEL AT THE DESIRED ALARM POINT.

The Dielectric switch value is set to High if at calibration time, the level of material in the vessel or pipe is above the alarm point i.e. for horizontal probes, the probe is immersed. After calibration, the actual alarm point is internally set to the captured capacitance minus the Sensitivity switch value. For example, if the capacitance at calibration was 100pF and the Dielectric switch was set to High then the actual alarm point is internally set to 100pF - the Sensitivity switch value (0-7pF only). So if the sensitivity switch is set to 5, the actual alarm point is 95pF. Increasing the Sensitivity switch setting thus increases the amount of level change required to switch from the alarm state at calibration.

Conversely, the Dielectric switch is set to Low if the level is below the alarm point during calibration. After calibration, the actual alarm point is internally set to the captured capacitance plus the Sensitivity switch value. For example, if the capacitance at calibration was 100pF and the Dielectric switch was set to Low then the actual alarm point is internally set to 100pF + the Sensitivity switch value. So if the sensitivity switch is set to 5, the actual alarm point is 105pF. Increasing the Sensitivity switch setting thus increases the amount of level change required to switch from the alarm state at calibration.

NOTES:

FOR VERTICAL PROBES, IT IS RECOMMENDED THAT CALIBRATION BE DONE WITH THE LEVEL AT THE DESIRED ALARM POINT. THE DIELECTRIC AND SENSITIVITY SWITCHES ARE NOT IMPORTANT AND MAY BE SET TO LOW AND 1 RESPECTIVELY.

THE DIELECTRIC SWITCH SETTING IS ONLY CAPTURED AT CALIBRATION TIME. IT'S SETTING AFTER CALIBRATION DOES NOT AFFECT OPERATION.

<u>HARDWARE REV.</u> 1.0	<u>SOFTWARE REV.</u> 9820_06 and higher	Page 9 of 14
-----------------------------	--	--------------

<u>MODEL</u> 9830 DIFF. LEVEL SWITCH	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> 09/19/2003 4:25 PM	<u>PRINT DATE</u> 09/19/2003 4:25 PM	

THE SENSITIVITY SWITCH VALUE IS READ CONTINUOUSLY. IT'S SETTING AFTER CALIBRATION DOES AFFECT OPERATION (THE SENSITIVITY VALUE IS ADDED TO OR SUBTRACTED FROM THE CAPACITANCE VALUE CAPTURED AT CALIBRATION TO PRODUCE THE NEW ALARM POINT.

1. For vertical capacitance probes, bring the level to the desired alarm point.
2. For horizontal probes, proximity sensors, or Dry Pump monitors, determine if the level is above or below the desired alarm point. If it is below, set the Dielectric switch to Low. Conversely, if it is higher than the desired alarm level, set the Dielectric switch to High.
3. Press the Calibrate push-button until the Status indicator glows orange. The Status indicator then starts flashing green indicating that the first alarm point has been stored.
4. Press the Calibrate push-button again until the Status indicator glows orange. The second alarm point is assigned the same level value as the first resulting in a single alarm point.
5. This completes the calibration procedure. The Status indicator should be a steady green.
6. Set the Sensitivity switch to some value other than 0pF. The amount depends on the application. The value sets the amount (in pF) the measured capacitance has to change from the current value to switch alarm states. NOTE: THE SENSITIVITY SWITCH RANGE IS 0 – 7pF. SWITCH SETTINGS 8 AND 9 ARE EQUIVALENT TO 0pF. A sensitivity value of 1 is most commonly used.

Please refer to section 3.5 below for setting the time delay and relay action.

### 3.5 ALARM SETTINGS

The relay is always in the failsafe condition: i.e. in alarm, the relay is off and vice versa.

NOTE: FOR ALL APPLICATIONS WHERE THE 9830 IS CONTROLLING PUMP ACTION, THE NORMALLY OPEN (NO) CONTACTS MUST BE USED TO ENSURE THE PUMP IS SHUT OFF IN THE EVENT OF A POWER FAILURE TO THE 9830. THE RELAY ACTION SWITCH MAY BE USED TO GIVE THE CORRECT CONTACT CONDITIONS.

There are 3 alarm settings:

1. RELAY ACTION. This is set via the Relay Action switch. When set to High, the failsafe relay is de-energized and alarm indicator is off when the level rises above the High Alarm point for at least the alarm delay period. The relay is energized and the Alarm indicator is on (with no time delay) when the level falls below the Low Alarm point.

Conversely, when the Relay Action switch is set to Low, the failsafe relay is de-energized and alarm indicator is off when the level drops below the Low Alarm point for at least the alarm delay period. The relay is energized and the alarm indicator is on (with no time delay) when the level rises above the High Alarm point

Note: for Single point alarms, the High and Low Alarm points are at the same level.

This switch is also used to switch contact conditions. For example, for pump control applications where the pump must be shut off in the event of a power failure to the 9830, the Normally Open contacts must be used. The state of the relay contacts during an alarm and power failure is changed using the Relay Action switch.

2. ALARM TIME DELAY. This is set via the Time Delay switch. An alarm based on the Relay Action switch must be present for at least the time delay value for the relay to switch to the alarm state. There is no delay when switching off the alarm. The delay range is 0 – 20 seconds.

<u>HARDWARE REV.</u> 1.0	<u>SOFTWARE REV.</u> 9820_06 and higher	Page 10 of 14
-----------------------------	--	---------------

<u>MODEL</u> <b>9830 DIFF. LEVEL SWITCH</b>	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> <b>09/19/2003 4:25 PM</b>	<u>PRINT DATE</u> 09/19/2003 4:25 PM	

<b>DELAY SWITCH SETTING</b>	<b>TIME DELAY</b>
0	0 seconds
1	2 seconds
2	4 seconds
3	6 seconds
4	8 seconds
5	10 seconds
6	15 seconds
7	20 seconds
8 & 9	Not used and act as 0 seconds.


The delay is always to enter the alarm condition (failsafe relay de-energized, alarm indicator off). If the Relay Action switch is set to High, the delay is applied to de-energize the failsafe relay as the level rises above the High Alarm Point. If the Relay Action switch is set to Low, the delay is applied to de-energize the failsafe relay as the level drops below the Low Alarm point.

3. SENSITIVITY SETTING. This has already been described in section 3.4. It is primarily used for horizontal probes, proximity sensors, or Dry Pump monitors. The switch setting is used to add to or subtract from the calibrated level value to add more immunity from noise and also to allow calibration to be performed without the level being at the desired alarm point. See the applications section for more details. Typical applications use a sensitivity setting of 1


## **THIS COMPLETES THE SETUP AND CALIBRATION PROCEDURE FOR THE 9830 LEVEL SWITCH**

<b>MODEL</b> 9830 DIFF. LEVEL SWITCH	<b>DOCUMENT TYPE</b> USER MANUAL	<b>DOCUMENT FILE NAME</b> 9830UM12.DOC	<b>REV.</b> 1.2
<b>CREATE DATE</b> 03/27/2003 9:06 PM	<b>REV. DATE</b> 09/19/2003 4:25 PM	<b>PRINT DATE</b> 09/19/2003 4:25 PM	

## 4.0 APPLICATIONS

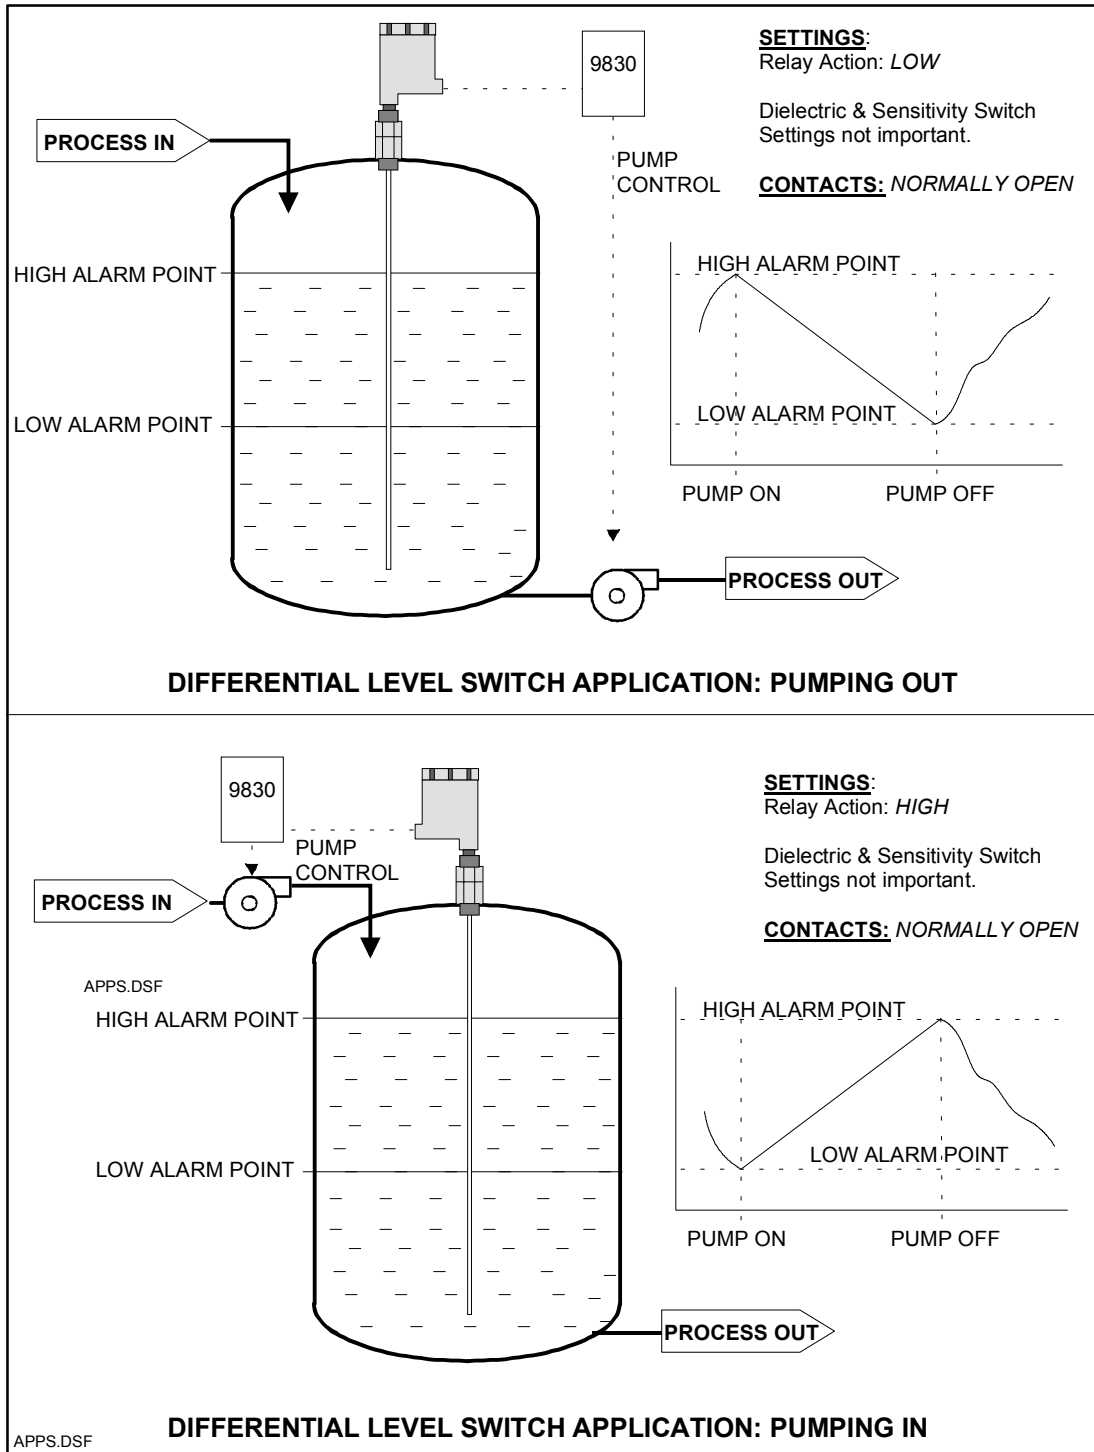

<u>MODEL</u> <b>9830 DIFF. LEVEL SWITCH</b>	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> <b>09/19/2003 4:25 PM</b>	<u>PRINT DATE</u> 09/19/2003 4:25 PM	

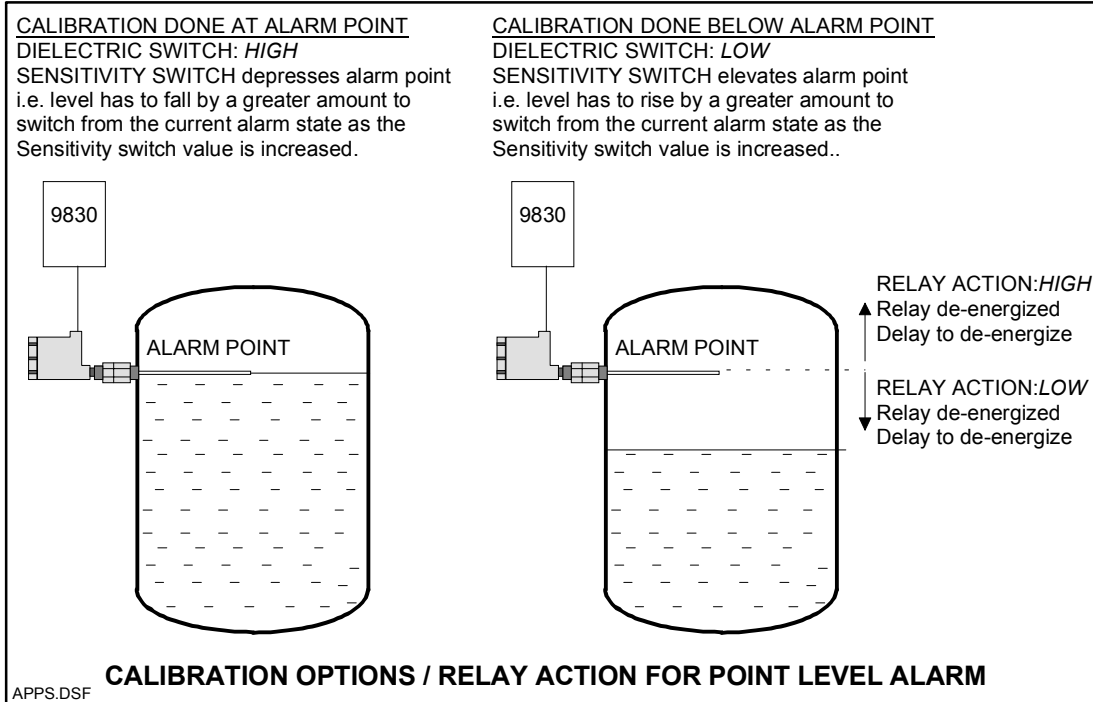


NOTES ON HORIZONTAL PROBES: If the probe is not shielded, the measured capacitance will slowly rise as the level approaches the probe based on the material in the tank, the tank shape and probe length. Therefore if the calibration is done while the level is below the probe using the Dielectric switch set to low the 9830 may trigger an alarm before the level actually reaches the probe. This discrepancy may be reduced by setting the sensitivity switch to its max. value of 7. **The application should be verified to ensure the resulting alarm point is at the desired level.**

<u>MODEL</u> <b>9830 DIFF. LEVEL SWITCH</b>	<u>DOCUMENT TYPE</u> USER MANUAL	<u>DOCUMENT FILE NAME</u> 9830UM12.DOC	<u>REV.</u> 1.2
<u>CREATE DATE</u> 03/27/2003 9:06 PM	<u>REV. DATE</u> <b>09/19/2003 4:25 PM</b>	<u>PRINT DATE</u> 09/19/2003 4:25 PM	


## 5.0 TROUBLESHOOTING

CONDITION	DO THIS
1. No indicators on at powerup	<ul style="list-style-type: none"> <li>• Check power to unit</li> <li>• Make sure power applied is as specified for the unit.</li> <li>• If power is ok, check the fuse. If the fuse is blown, call an Arjay representative to analyze why the fuse has blown.</li> </ul>
2. Status indicator is RED	<ul style="list-style-type: none"> <li>• This indicates that the probe signal is either weak, unstable, out of legal range, or is not present.</li> <li>• Unplug the probe (sensor) connector from the 9830. Verify that the polarity of the two wire shielded connection is correct.</li> <li>• Make sure there is no break in the wiring between controller and PMC 2000 card.</li> <li>• Make sure there is a PMC 2000 card mounted in the remote junction box.</li> <li>• Replace the PMC 2000 card with a spare if available.</li> </ul>
3. False alarms	<ul style="list-style-type: none"> <li>• Add some time delay to unit.</li> <li>• Make sure there is no outside interference that may be causing false alarms such as an agitator, high voltage interference, or input flow to the tank affecting the probe.</li> <li>• Adjust the sensitivity switch to next setting to decrease the 9830's sensitivity. Test sensor after the setting has been increased to make sure the sensor can still reliably sense the presence of liquid.</li> </ul>

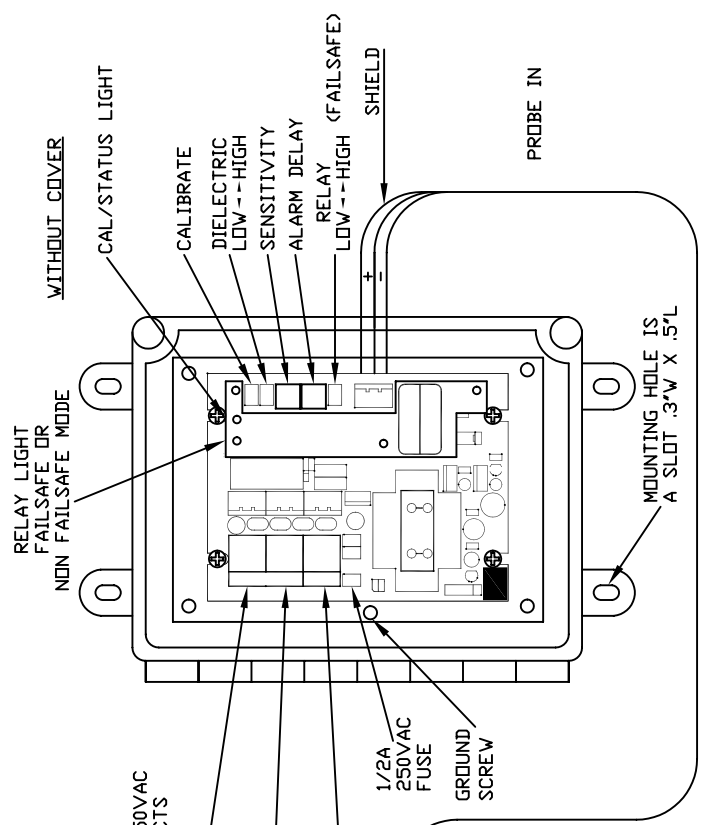

TYPE 4X FIBERGLASS ENCLOSURE

NOTE: VOLTAGE PER ORDER  
 INPUT 24VDC, 115VAC, 220VAC  
 TERMINALS MARKED (-) (+) ARE FOR DC POWERED UNITS

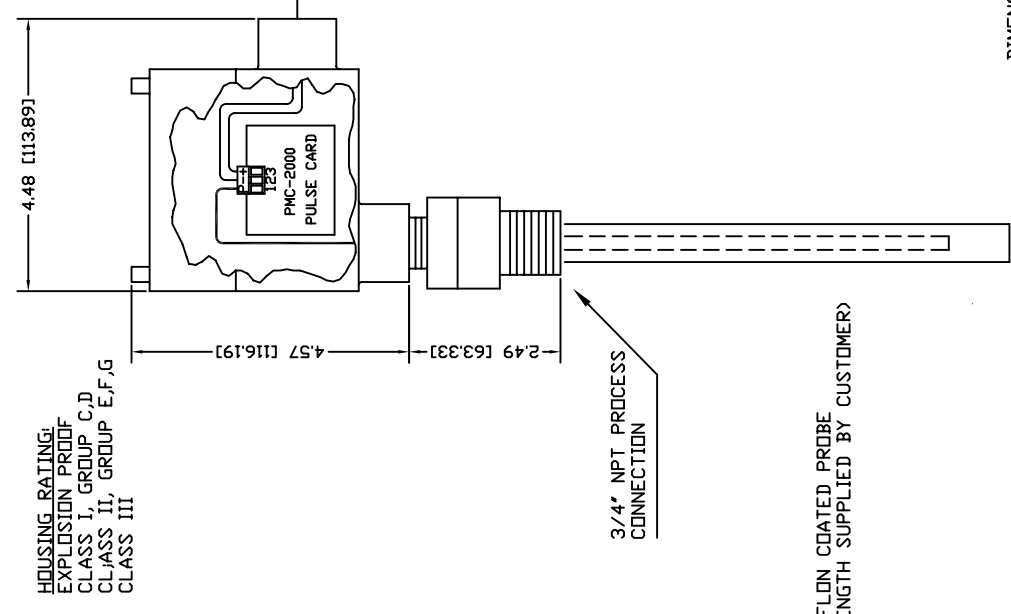

TEFLON COATED PROBE (LENGTH SUPPLIED BY CUSTOMER)

DIMENSIONS ARE IN INCHES AND [mm(s)]  
 ENCLOSURE IS A HOFFMAN A-864CHORFG  
 ENCLOSURE DIMENSIONS ARE 8.5 X 7 X 4.5D (219.5 X 177.8 X 114.3D)  
 ENCLOSURE MOUNTING DIMENSIONS ARE 9 X 4 (228.6 X 101.6)

1	26/3/03	CHANGED ENCLOSURE TYPE		CHK'D	APP'D
REV	DATE	DESCRIPTION			

REVISIONS

**ARJAY ENGINEERING LIMITED**

PROJECT: REMOTE MOUNTED LEVEL SWITCH

DWG. STATUS	BY	DATE	TITLE
DRAWN	C.M.P.	3/99	9830
CHECKED			
APPROVED			
SCALE	REF. DWGS.	DWG. NO.	REV.
N.T.S.		990201	1 1

DIMENSIONAL & ELECTRICAL DRAWING